



G8813.04-303-11-R0
ACOUSTICAL PERFORMANCE TEST REPORT
ASTM E90

Rendered to:

NEON ENERGY

Series/Model: ULTRA

Type: Horizontal Sliding Window

Summary of Test Results			
Data File No.	Glazing (Nominal Dimensions)	STC	OITC
G8813.04	24 mm (1") IG (6 mm (1/4") tempered interior, 13 mm (1/2") air space, 5 mm (3/16") annealed exterior)	27	25

Reference should be made to Intertek-ATI Report No. G8813.04-303-11 for complete test specimen description. This page alone is not a complete report. Flanking limit tests and reference specimen tests are available upon request.



Acoustical Performance Test Report

NEON ENERGY
4989 East La Palma Avenue
Anaheim, California 92807

Report No	G8813.04-303-11
Test Date	03/27/17
Report Date	05/15/17

Project Scope

Architectural Testing, Inc., an Intertek company ("Intertek-ATI"), was contracted to conduct a sound transmission loss test. The complete test data is included as Appendix B of this report. The client provided the test specimen.

Test Methods

Testing for this project was conducted in accordance with the following standards. The equipment listed in the attachments meets the requirements of the following standards.

ASTM E90-09(2016), *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements*

ASTM E413-10, Classification for Rating Sound Insulation

ASTM E1332-10a, *Standard Classification for Rating Outdoor-Indoor Sound Attenuation*

ASTM E2235-04(2012), *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*

Test Procedure

All measurements were conducted in the HT test chambers at Intertek-ATI located in Lake Forest, California. The sensitivity of the microphones was checked before measurements were conducted.

The transmission loss values were obtained for a single direction of measurement. Two background noise sound pressure level and five sound absorption measurements were conducted at each of five microphone positions.

Two sound pressure levels were made simultaneously in the receive and source rooms at each of five microphone positions.

The air temperature and relative humidity conditions were monitored and recorded during all measurements.

Specimen Installation

A sound transmission loss test was initially performed on a filler wall.

The specimen plug was removed from the filler wall assembly. A filler wall-reducing element was used to adjust the test opening size to accommodate the test specimen. The reducing element consisted of a double 2x6 wood stud wall construction with three layers of 5/8" drywall on both sides. The stud cavities in the wall were insulated with two layers of R-13 fiberglass insulation. The specimen was placed on a foam isolation pad in the custom test opening. Duct seal was used to seal the perimeter of the specimen to the test opening on both sides. The interior side of the specimen, when installed, was approximately 1/4" from being flush with the receive room side of the filler wall. A stethoscope was used to check for any abnormal air leaks around the test specimen prior to testing. Operable portions of the test specimen, if any, were cycled at least five times prior to testing.

Test Calculations

Transmission loss (TL) at each 1/3 octave frequency is the average source room sound pressure level minus the average receive room sound pressure level, plus, 10 times the log of the specimen area divided by the sound absorption of the receive room with the sample in place.

STC Rating

To obtain the Sound Transmission Class (STC), read the TL of the contour curve at 500 Hz. The sum of the deficiencies below the contour curve must not exceed 32. The maximum deficiency at any one frequency must not exceed 8.

OITC Rating

The Outdoor-Indoor Transmission Class (OITC) is calculated by subtracting the logarithmic summation of the TL values from the logarithmic summation of the A-weighted transportation noise spectrum stated in ASTM E1332.

Specimen Descriptions

	Frame	Active Panel
Size	59-1/8" by 47-1/4"	30-1/8" by 44-3/4"
Thickness	3-1/2"	1-3/8"
Corners	Mitered	Mitered
Fasteners	Screws	Keys
Seal Method	Sealant	N/A
Material	Aluminum	Aluminum
Reinforcement	N/A	N/A
Thermal Break Material	Insulbar	Insulbar
Daylight Opening Size	22-3/4" by 37-1/4"	22-3/4" by 37-1/2"

Measured Overall Insulation Glass Unit Thickness	0.976"
Spacer Type	Aluminum with butyl

	Exterior Sheet	Gap	Interior Sheet
Measured Thickness	0.233"	0.512"	0.231"
Muntin Pattern	N/A	N/A	N/A
Material	Annealed	Air*	Tempered
Laminate Material	N/A	N/A	N/A

Glazing Method	Channel
Glazing Bead Material	NA

* - Stated per Client/Manufacturer, N/A-Not Applicable

Specimen Descriptions (Continued)

TYPE	QUANTITY	LOCATION
Weatherstrip		
0.207" by 0.290" Polypile	2 Rows	Perimeter of panels
0.207" by 0.290" Polypile	1 Row	Interior side of frame perimeter
0.250: by 0.250" hollow rubber gasket	2 Rows	Perimeter of frame
Hardware		
None		
Drainage		
1" by 1/4" weep with cover	3	Sill on active side of unit

Total Weight (lbs)	Average Weight (lbs / ft ²)
134	6.91

* - Stated per Client/Manufacturer, N/A-Not Applicable

Comments

The client did not supply a report drawing of the test specimen. Intertek-ATI will store test specimen samples for four years.

Intertek-ATI will service this report for the entire test record retention period. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained by Intertek-ATI for the entire test record retention period. The test record retention period ends four years after the test date.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen tested. This report is intended to help in the client's quality assurance program, but it does not represent a continuous or exhaustive evaluation of the specimen tested or of other products or materials that were not evaluated. The statements and data provided herein do not constitute approval, disapproval, certification, or acceptance of performance or materials.

This report may not be reproduced, except in full, without the written approval of Intertek-ATI.

For INTERTEK-ATI:

Leeland S. Hoover
Technician I - Acoustical Testing

Bradlay D. Hunt
Laboratory Manager – Acoustical Testing

LSH:bh/ss

Attachments (pages): This report is complete only when all attachments listed are included.

Appendix A: Equipment description (1)

Appendix B: Complete test results (2)

Appendix C: Photographs (1)



Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
R0	05/15/17	N/A	Original Report Issue

Appendix A

Instrumentation:

Instrument	Manufacturer	Model	Description	ATI Number	Date of Calibration
Data Acquisition Chassis	National Instruments	PXI-1033	Data Acquisition Chassis	INT00392	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00395	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00396	10/16
Data Acquisition Card	National Instruments	PXI-4462	Data Acquisition Card	INT00397	10/16
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00249	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00250	04/17
Source Room Microphone	PCB Electronics	378B20	Microphone and Preamplifier	INT00251	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00252	04/17
Source Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00248	04/17
Receive Room Microphone	PBC Piezotronics	378B20	Microphone and Preamplifier	INT00234	03/16
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00235	03/16
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00236	03/16
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00237	03/16
Receive Room Microphone	PCB Piezotronics	378B20	Microphone and Preamplifier	INT00238	03/16
Receive Room Environmental Indicator	Comet	T7510	Receive Room	INT00299	10/16
Source Room Environmental Indicator	Comet	T7510	Source Room	INT00300	10/16
Microphone Calibrator	Norsonic	1251	Pistonphone Calibrator	00288	04/16

*- Note: The calibration frequency for this equipment is every two years per the manufacturer's recommendation.

Test Chamber:

	Volume	Description
Receive Room	231 m ³	Rotating vane and stationary diffusers Temperature and humidity controlled Isolation pads under the floor
Source Room	200 m ³	Stationary diffusers only and humidity controlled Temperature

	Maximum Size	Description
TL Test Opening	4.27 m wide by 3.05 m high	Vibration break between source and receive rooms

N/A-Non Applicable



G8813.04-303-11

Appendix B

Complete Test Results

AIRBORNE SOUND TRANSMISSION LOSS

ASTM E 90

Test Date	03/27/17						
Data File No.	G8813.04						
Client	Neon Energy						
Description	Series/Model: Ultra Horizontal Sliding Window with (1") 24 mm IG((1/4)6mm tempered interior, (1/2)13mm air space,(3/16) 5mm annealed exterior)						
Specimen Area	1.80 m ²	Receive Temp.	21.9 °C		Source Temp.	21.6 °C	
Technician	Leeland S. Hoov	Receive Humidity	51%		Source Humidity	49%	

Freq (Hz)	Background SPL (dB)	Absorption (m ²)	Source SPL (dB)	Receive SPL (dB)	Specimen TL (dB)	95% Confidence Limit	Number of Deficiencies
80	38.9	4.7	105	79	22.2	1.87	-
100	36.3	4.8	105	80	21.7	1.46	-
125	40.6	5.1	105	81	19.1	1.17	0
160	44.3	5.0	103	76	22.6	1.13	0
200	36.6	6.4	106	82	18.5	0.94	0
250	23.8	6.7	106	72	28.0	0.66	0
315	19.2	6.7	107	74	27.0	0.60	0
400	19.1	6.0	107	75	27.3	0.39	0
500	21.6	5.5	108	77	26.3	0.43	1
630	17.8	5.8	106	75	25.8	0.47	2
800	19.1	6.0	106	75	25.0	0.30	4
1000	13.2	6.2	107	77	25.1	0.21	5
1250	12.4	6.3	106	74	26.5	0.29	5
1600	11.7	6.8	103	70	27.1	0.17	4
2000	10.2	7.8	102	67	28.2	0.33	3
2500	7.8	8.5	102	65	30.2	0.21	1
3150	6.5	9.5	101	61	32.2	0.24	0
4000	6.2	11.4	99	58	33.6	0.27	0
5000	6.0	14.3	99	55	34.6	0.22	-

STC Rating **27** *(Sound Transmission Class)*
Deficiencies **25** *(Sum of Deficiencies)*
OITC Rating **25** *(Outdoor-Indoor Transmission Class)*

Notes:


- 1) Receive Room levels less than 5 dB above the Background levels are red.
- 2) Specimen TL levels listed in red indicate the lower limit of the transmission loss.
- 3) Specimen TL levels listed in green indicate that there has been a filler wall correction applied

AIRBORNE SOUND TRANSMISSION LOSS

ASTM E 90

Test Date	03/27/17					
Data File No.	G8813.04					
Client	Neon Energy					
Description	Series/Model: Ultra Horizontal Sliding Window with (1") 24 mm IG((1/4)6mm tempered interior, (1/2)13mm air space,(3/16) 5mm annealed exterior)					
Specimen Area	1.80 m ²	Receive Temp.	21.9 °C		Source Temp.	21.6 °C
Technician	Leeland S. Hoov	Receive Humidity	51%		Source Humidity	49%

Airborne Sound Transmission Loss

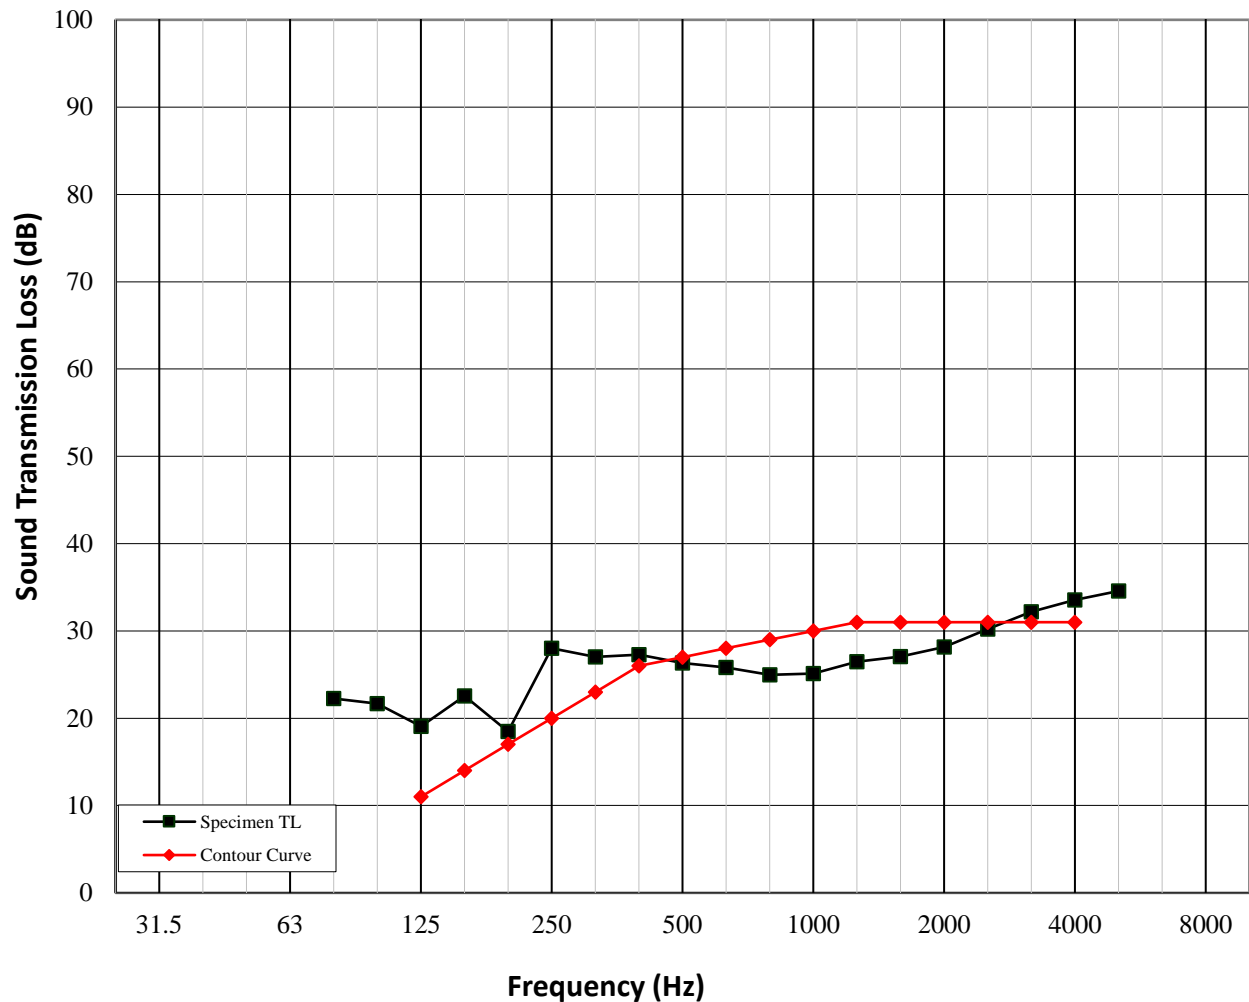


Appendix C

Photographs



Source Room View of Test Specimen

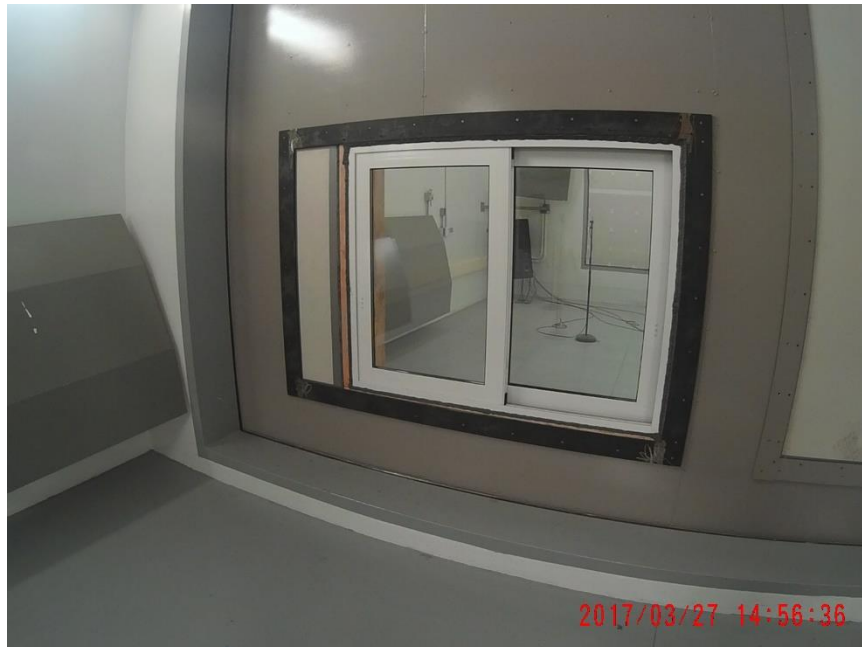

Receive Room View of test Specimen